

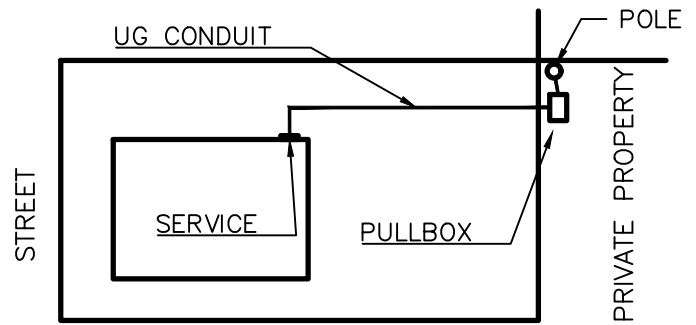



**CASE 1: BACKYARD POLE LINE (NEW UG)** – BWP INSTALLS CONDUCTOR TO 1ST PULLBOX, CONTRACTOR INSTALLS FROM PULLBOX TO PANEL.

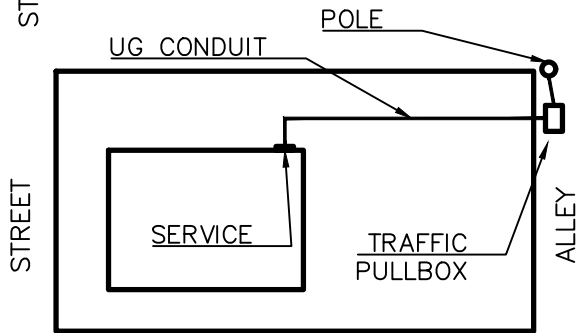

**CASE 2: BACKYARD POLE LINE (EXISTING UG)** – CONTRACTOR INSTALLS CONDUCTOR FROM PULLBOX TO PANEL, BWP TERMINATES INSIDE PULLBOX. BWP MUST BE ONSITE DURING WORK INSIDE ENERGIZED BOX. CONTRACTOR RESPONSIBLE TO COORDINATE ACCESS TO PULLBOX IF NOT LOCATED ONSITE.

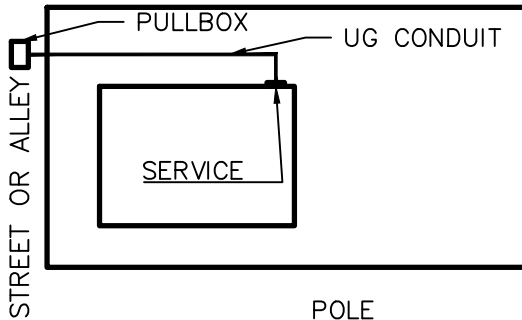

**CASE 3: STREET/ALLEY (PULLBOX ADJACENT TO PROPERTY)** – BWP INSTALLS CONDUCTOR TO PULLBOX ADJACENT TO PROPERTY, CONTRACTOR INSTALLS FROM PULLBOX TO PANEL. BWP MUST BE ONSITE DURING CONDUIT WORK INSIDE ENERGIZED BOX IF REQUIRED.

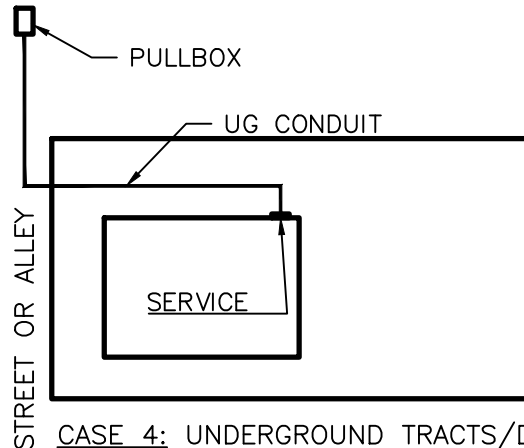

**CASE 4: UNDERGROUND TRACTS/DISTRICTS OR STREET/ALLEY (PULLBOX NOT ADJACENT TO PROPERTY)** – BWP INSTALLS CONDUCTOR TO PANEL. BWP MUST BE ONSITE DURING CONDUIT WORK INSIDE ENERGIZED BOX IF REQUIRED.

**NOTES:**

1. CONTRACTOR INSTALLS ALL SUBSTRUCTURE INCLUDING CONDUIT, PULLBOXES, AND RISER FIRST 10FT UP POLE. BWP INSTALLS STANDOFFS PRIOR TO CONDUIT PLACEMENT TO DETERMINE POLE QUADRANT. REFER TO S-707, S-810, S-811, AND CONFIRMATION OF ELECTRIC SERVICE (METER SPOT) FOR DETAILED REQUIREMENTS.
2. ANY CONDUIT WITHIN THE BUILDING ENVELOPE SHALL BE INSPECTED BY BUILDING AND SAFETY.
3. BWP INSTALLS CONDUCTOR INSIDE POLE RISER.
4. ANY WORK INSIDE EXISTING ENERGIZED STRUCTURES MUST BE PERFORMED UNDER BWP SUPERVISION AFTER RECEIVING CLEARANCE FROM BWP PERSONNEL ONSITE.
5. CONTRACTOR MUST LEAVE MINIMUM 4 FEET CONDUCTOR IN PULLBOX FOR BWP TO CONNECT TO. BWP MAKES/INSTALLS ALL UNDERGROUND (SUBMERSIBLE) TERMINATIONS IN PULLBOXES
6. IF CONTRACTOR PULLS INTO PANEL PULL SECTION, CONTRACTOR TERMINATES IN PANEL. IF BWP PULLS INTO PANEL PULL SECTION BWP TERMINATES IN PANEL.
7. SEE CONFIRMATION OF ELECTRIC SERVICE (METER SPOT) FOR SITE SPECIFIC REQUIREMENTS.

					<b>BURBANK WATER AND POWER – ELECTRIC SERVICES</b>	
					DRAWING No.	
				<b>SECONDARY DELINEATION OF RESPONSIBILITIES (OFFSITE TRANSFORMATION)</b>		<b>S-834A</b>
				Sheet 1 of 1		
A	NEW DWG	SK	VOA	5/21/26		
No.	REVISIONS	BY	APPR'V'D	DATE		