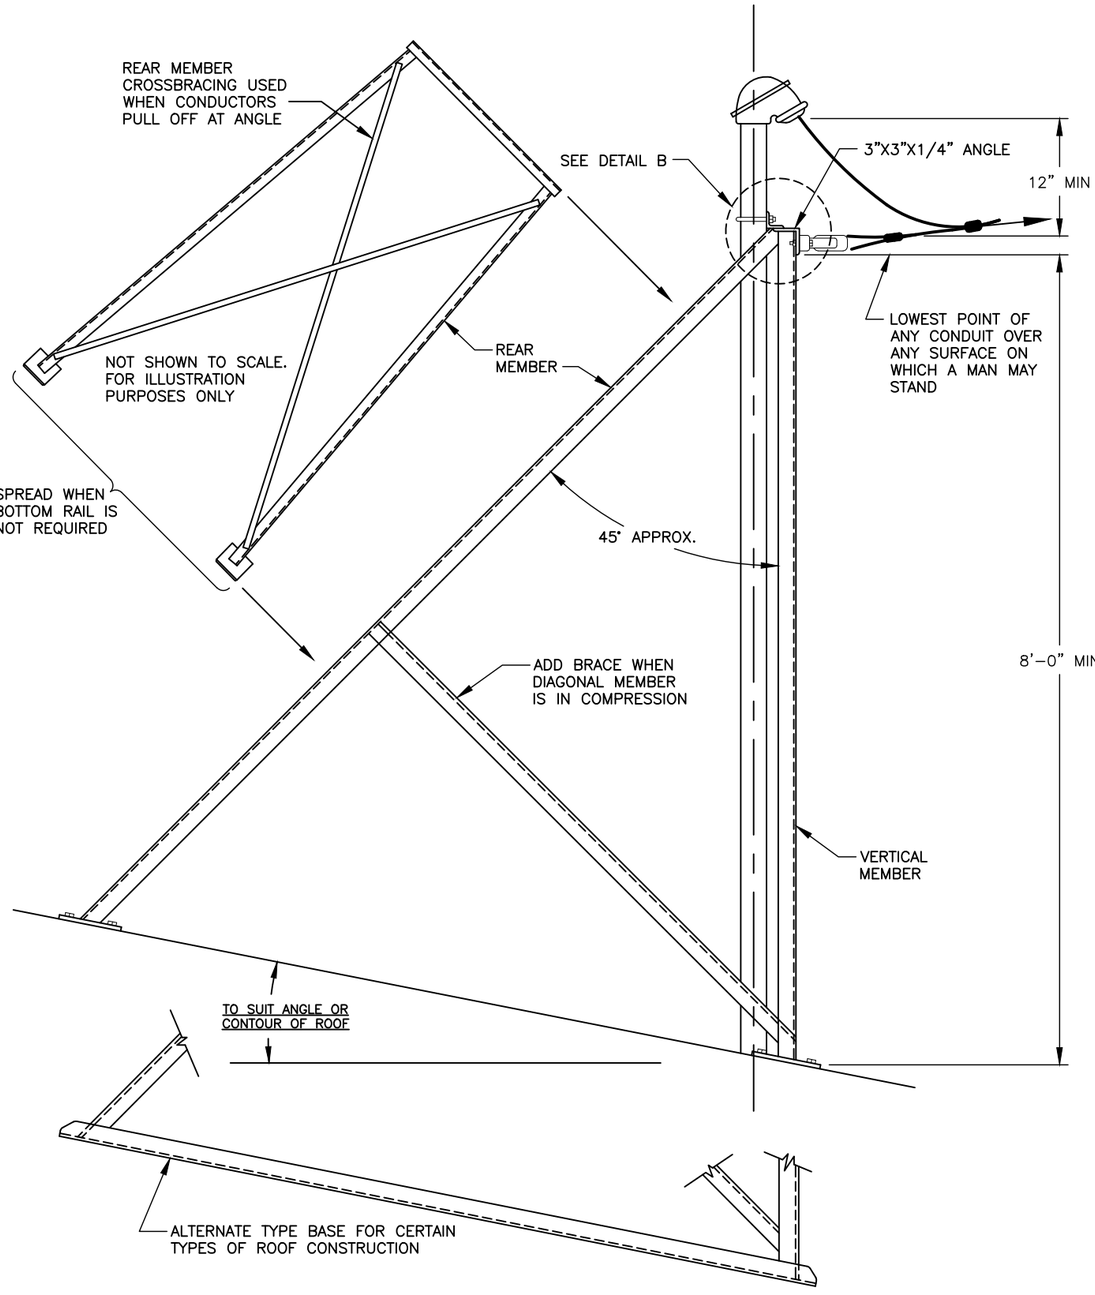

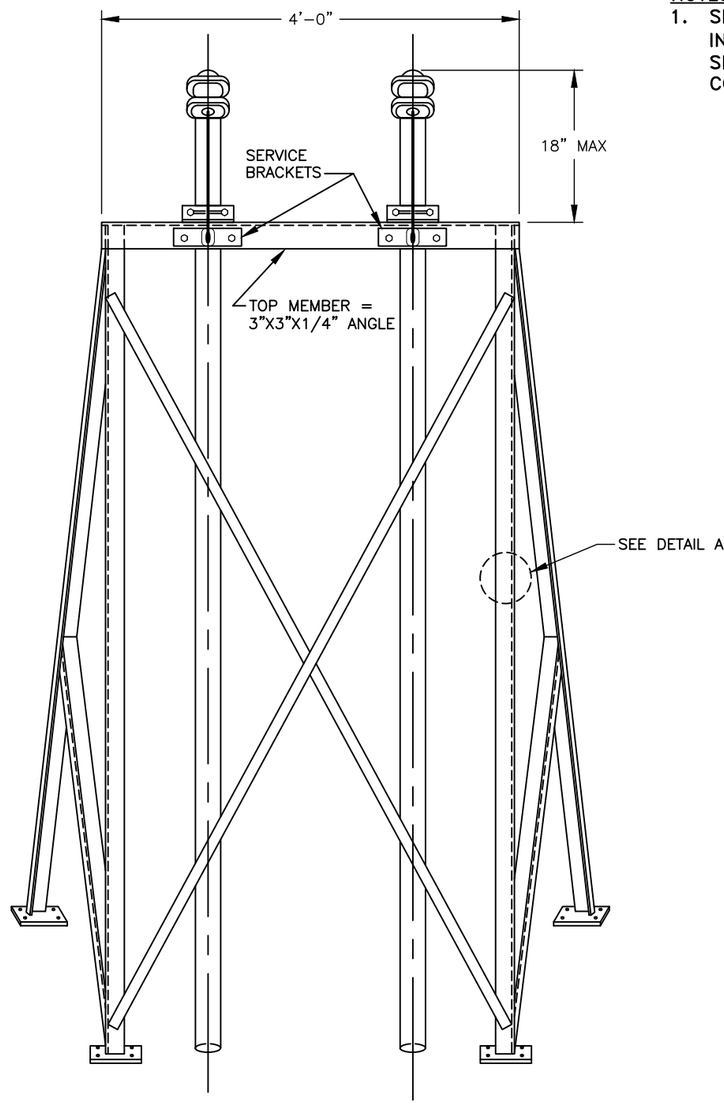

NOTES:

1. SERVICE BRACKETS AVAILABLE AT BWP YARD (TO BE INSTALLED BY CONTRACTOR). ALL OTHER MATERIAL SHALL BE FURNISHED AND INSTALLED BY CONTRACTOR. COORDINATE WITH BWP SERVICE PLANNER.



DETAIL A
N.T.S.

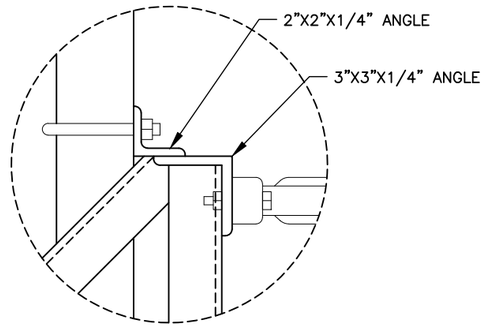

DETAIL B
N.T.S.

FRAME = 2"X2"X1/4" ANGLE EXCEPT AS NOTED

DIAGONAL BRACING = 1/4"X1" IRON STRAP

DWG. NO.	DESCRIPTION

CROSS REFERENCES

NO.	DESCRIPTION	BY	CHECK	APP'VD	DATE
A	RENUMBERED FROM BE-119	MEP		CJC	5/9/23

REVISIONS

CITY OF BURBANK
WATER AND POWER

BURBANK WATER AND POWER

ELECTRICAL SERVICES DIVISION
TYPICAL OVERHEAD
SERVICE RACK

DRAWN LWP	DATE 12/5/50	O.K.
CHECKED GRT	SCALE NONE	O.K.
APPROVED AEC — SENIOR ELECTRICAL ENGINEER		S-829A